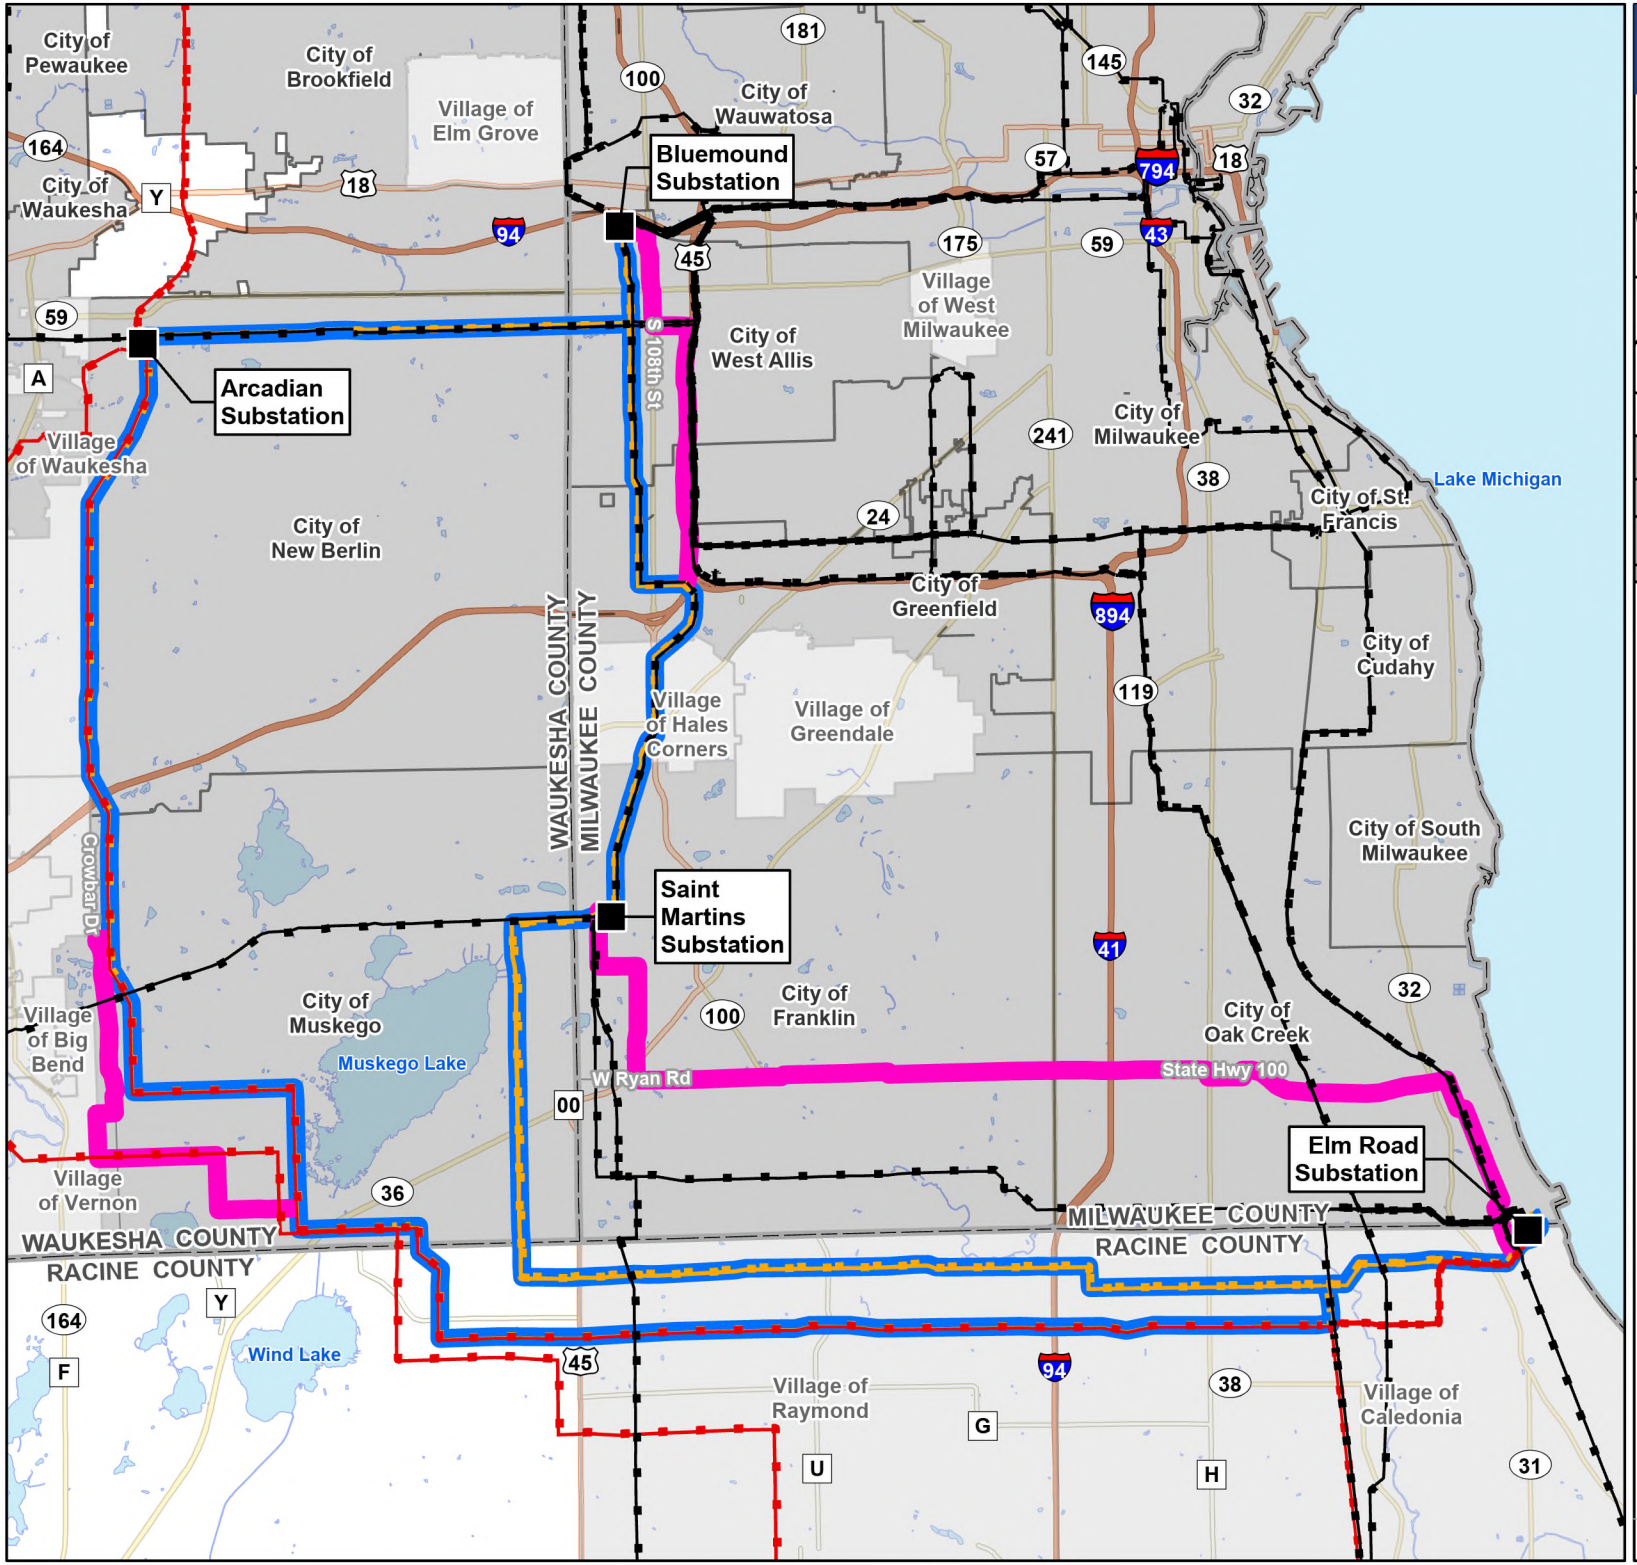

FIGURE 1
Project Overview

BLUEMOUND TO ELM ROAD UPGRADE PROJECT

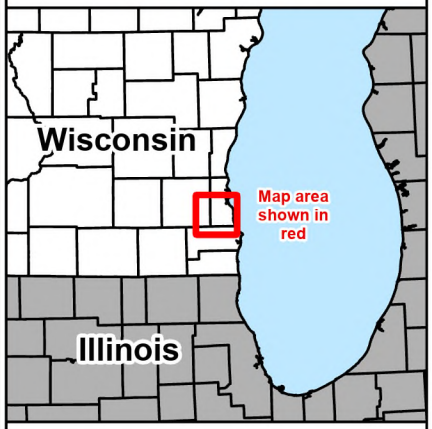

PROJECT RELATED DATA

- Existing Project Substation

Power Line Route Options

- Rebuild Routes (Existing Corridors)
- Alternate Segments

Existing Electric Transmission Line

- 138 kilovolts
- 230 kilovolts
- 345 kilovolts

Municipal Boundary

- City
- Village
- County Boundary

Power line route options are preliminary and are subject to change.

0 1 2 Miles

N W E S

ATC

The information presented in this map document is advisory and is intended for reference purposes only. Applicant owned and operated facility locations are approximate.

Base Map Data Sources: ATC, Stantec, Esri, WDOT, USCB, USGS.

MAY 2026